


DS-K1T Series Terminal Connect to Fire Alarm Signal

1. Operation Process

- 1) Confirm fire alarm signal type
- 2) Select corresponding port to connect
- 3) Test

2. Operation Steps:

- 1) Confirm fire alarm signal type, fire alarm signal should be normal close(NC) signal. If the signal type is 12V or 24V current, please transfer to NC signal through relay first.
- 2) Follow below diagram to connect cable

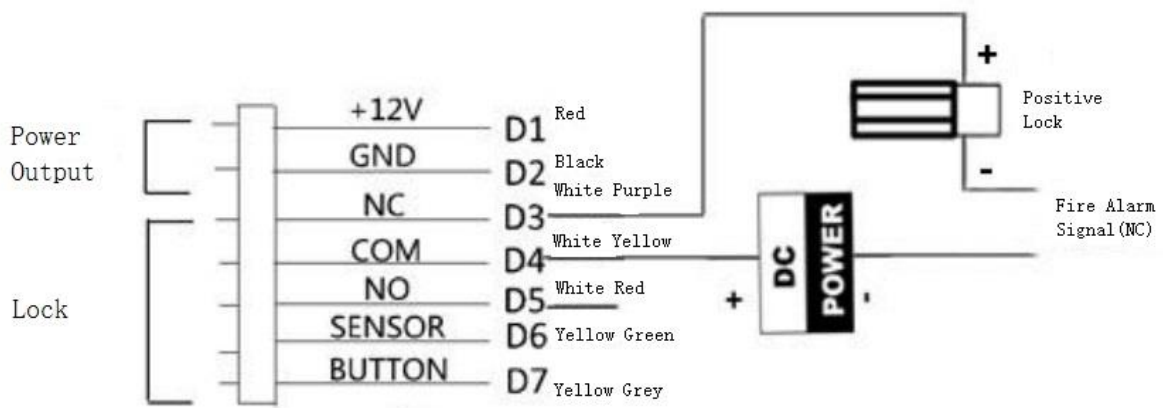

3) Test

Trigger fire alarm and check whether door will open or not;

Suitable Models:

Model	
DS-K1T105E/M	DS-K1T105E/M -C
DS-K1T804EF/MF	DS-K1T804EF/MF -1
DS-K1T201EF/MF	DS-K1T201EF/MF -C